



# Dimensions

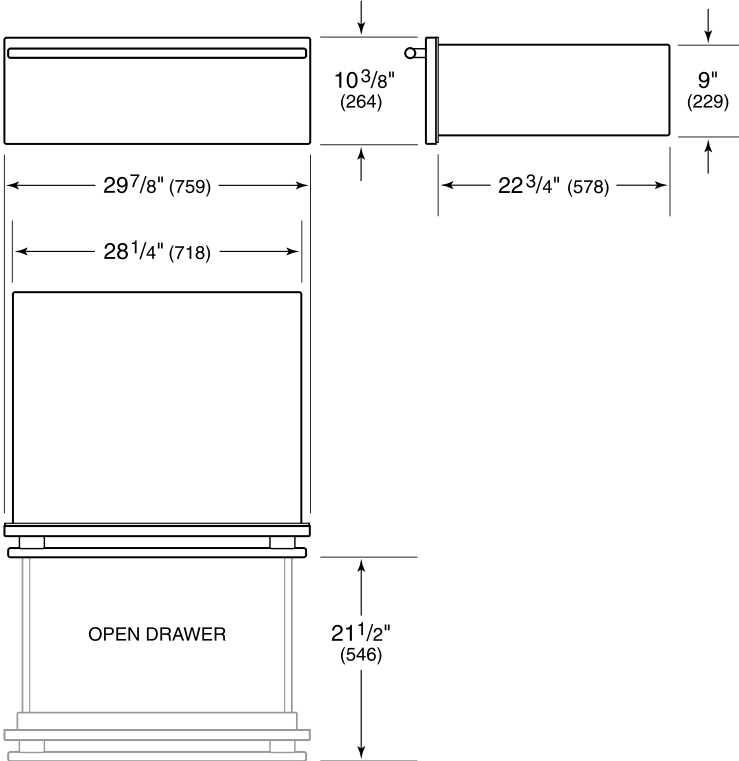

# Standard Installation

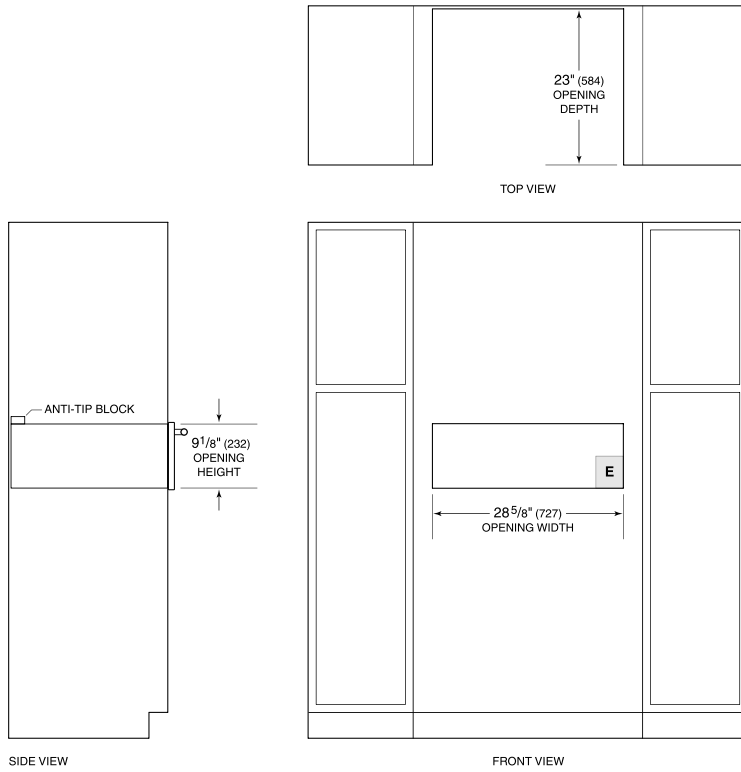

NOTE: Location of electrical supply within opening may require additional cabinet depth.

# Electrical Requirements

## Electrical Requirements


Electrical Supply 120 VAC, 60 Hz  
 Electrical Service 15 amp dedicated circuit

## Electrical Location Illustration



ELECTRICAL SUPPLY WITHIN  
 OPENING OR IN ADJACENT  
 CABINET WITHIN REACH OF  
 POWER CORD

# flush-installation

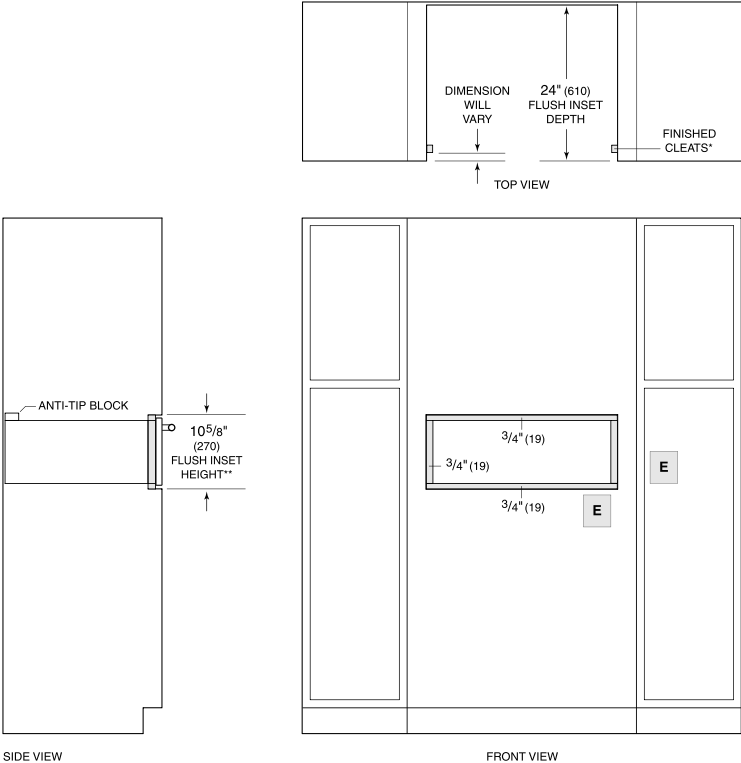

\*Will be visible and should be finished to match cabinetry.  
 NOTE: Location of electrical supply within opening may require additional cabinet depth.